



REVISIONS					
P	LTR	DESCRIPTION	DATE	DWN	APVD
	A	REV PER ECO 19-004954	4-1-19	CT	PD

D

C

B

A

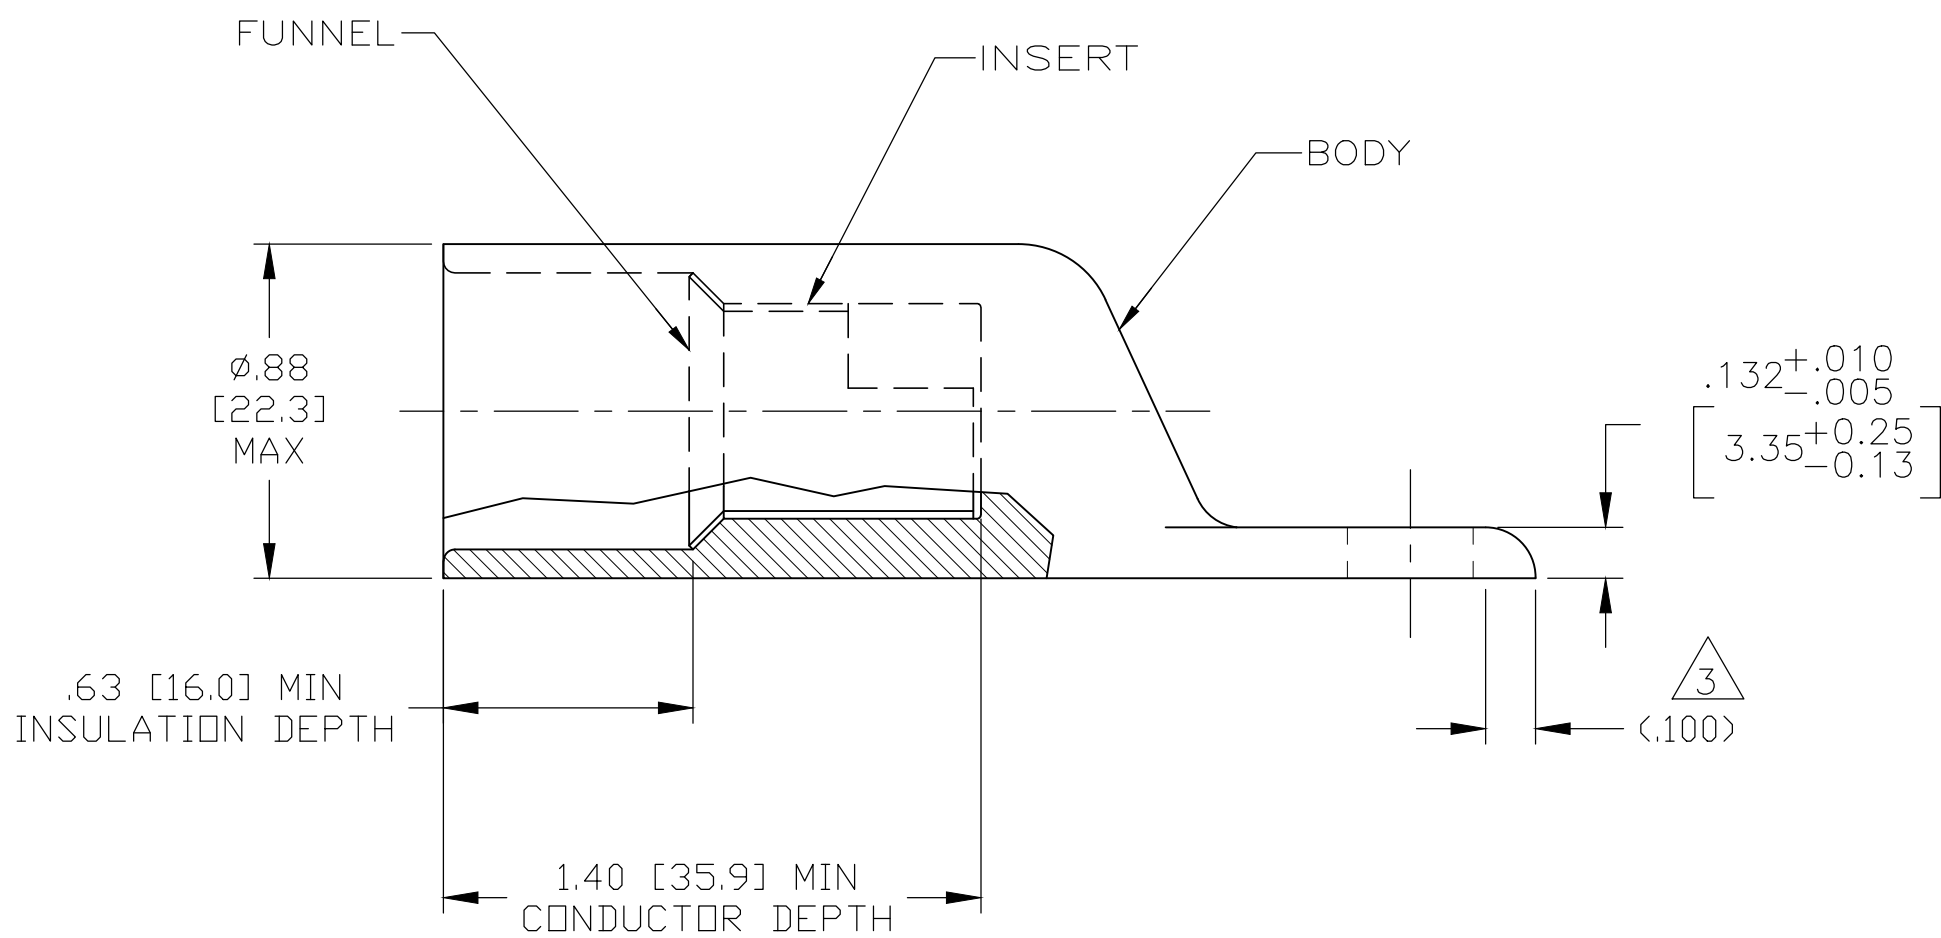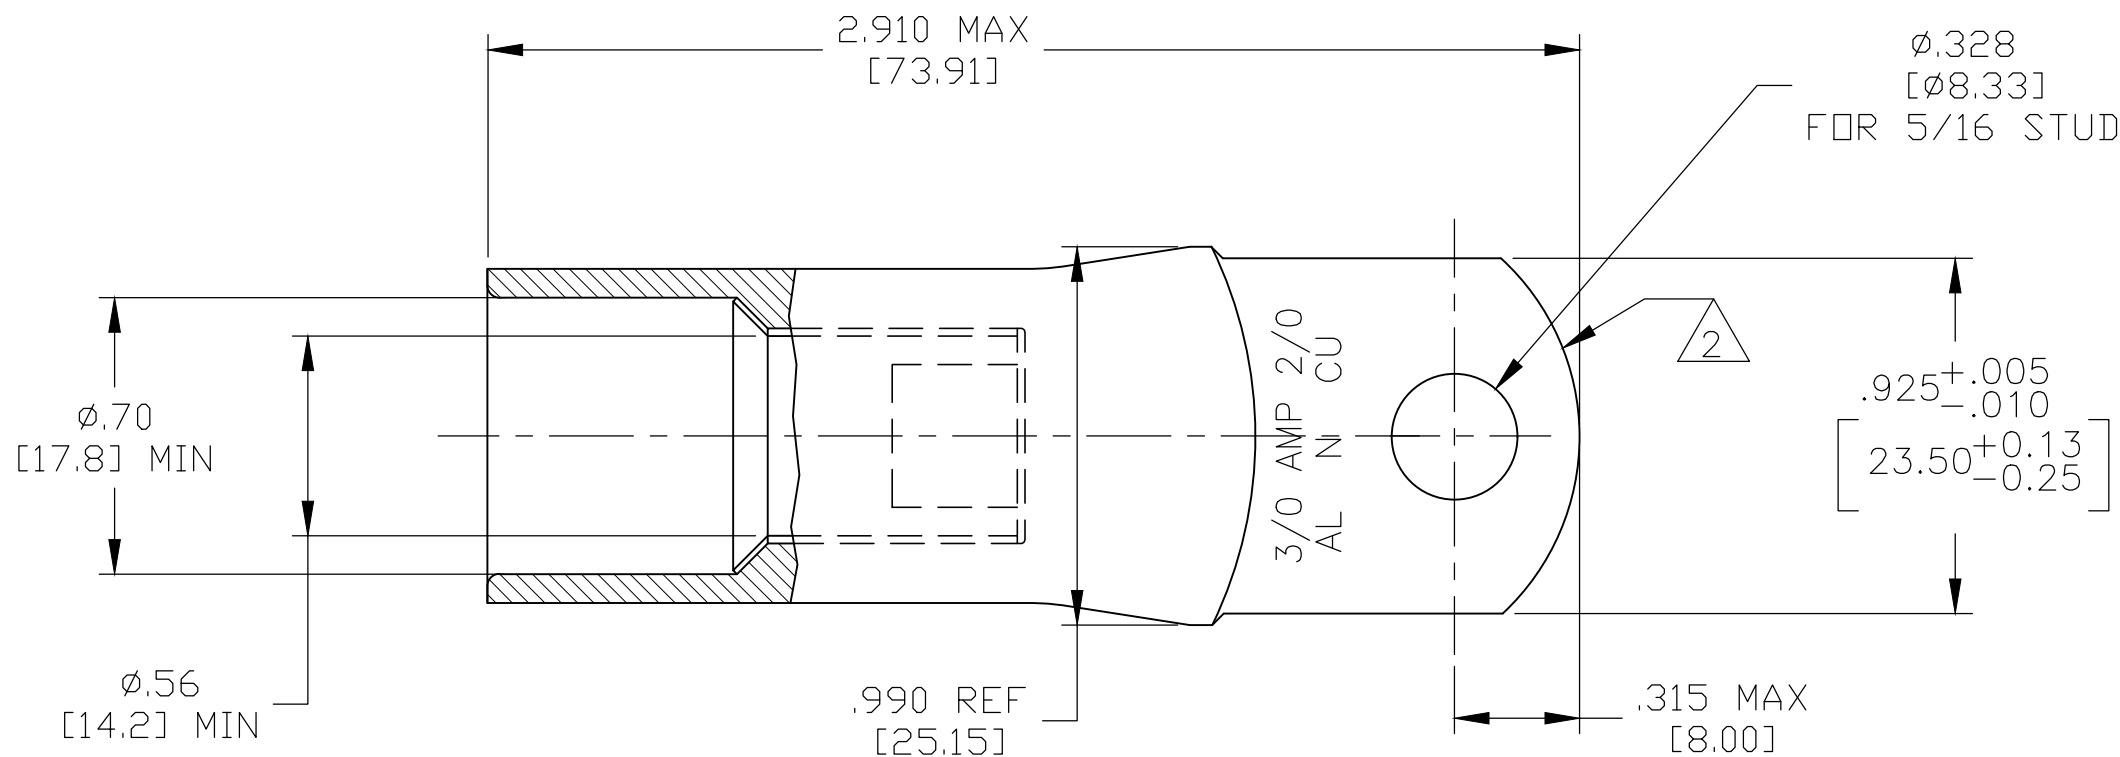

1. WIRE INSULATION: .520 [13.21]–.645 [16.38] DIA
2. THE TONGUE RADIUS FEATURE IS NOT A TOOLING CONTROLLED DIMENSION AND MAY NOT BE A TRUE RADIUS.
3. POINT OF NICKEL PLATING THICKNESS MEASUREMENT.
4. IF USING COPPER WIRE, HEAT SHRINK TUBING IS REQUIRED TO BUILD UP THE WIRE INSULATION IN ORDER TO MEET THE REQUIRED INSULATION RANGE.
5. SEE INSTRUCTION SHEET 408-2281 FOR TOOLING AND CRIMP INSTRUCTIONS.

BODY: COPPER PER ASTM-B187 ANNEALED NICKEL PLATE .000300 [0.00762] MIN THK PER QQ-N-290	2332930-1
INSERT & FUNNEL: BRASS PER ASTM B36 NICKEL PLATE SAE AMS QQ-N-290A, DATED JULY 2000, .000100 [0.00254] MIN THK	
MATERIAL AND FINISH	TE PART NO.

THIS DRAWING IS A CONTROLLED DOCUMENT.		DWN 6-25-18 C.C.THOMAS	TE Connectivity		
DIMENSIONS: INCHES [mm]		CHK 6-25-18 P.D'AMATO			
		APVD 6-25-18 P.D'AMATO	NAME		
		PRODUCT SPEC 108-2300-1	WIRE TERMINAL, RING TONGUE, SEALED COPALUM, 3/0 AL 2/0 CU		
MATERIAL SEE TABLE		APPLICATION SPEC 114-2134	SIZE	CAGE CODE	DRAWING NO
		FINISH SEE TABLE	WEIGHT 0	A2 00779	C-2332930
CUSTOMER DRAWING			SCALE 2:1	SHEET 1 OF 1	REV A

2332930

B

A